



OCCUPANCY SENSORS WIRED TO A PELICAN PEARL ECONOMIZER CONTROLLER

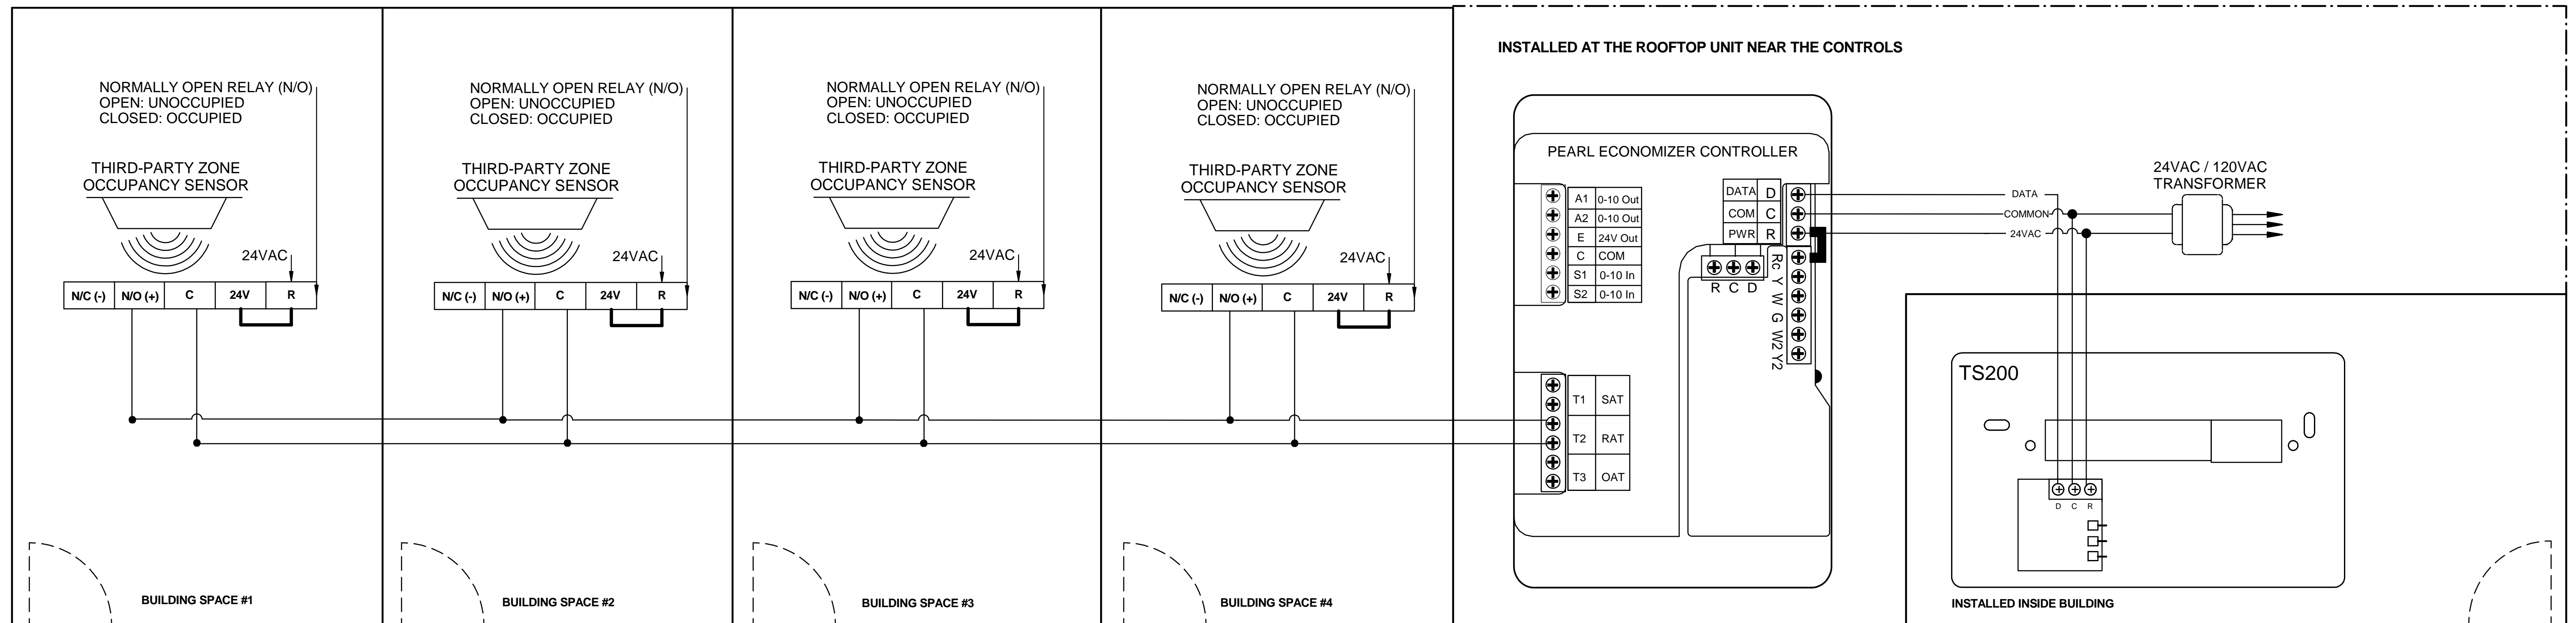

OCCUPANCY SENSORS WIRED TO A PELICAN TA1 AND PELICAN THERMOSTAT

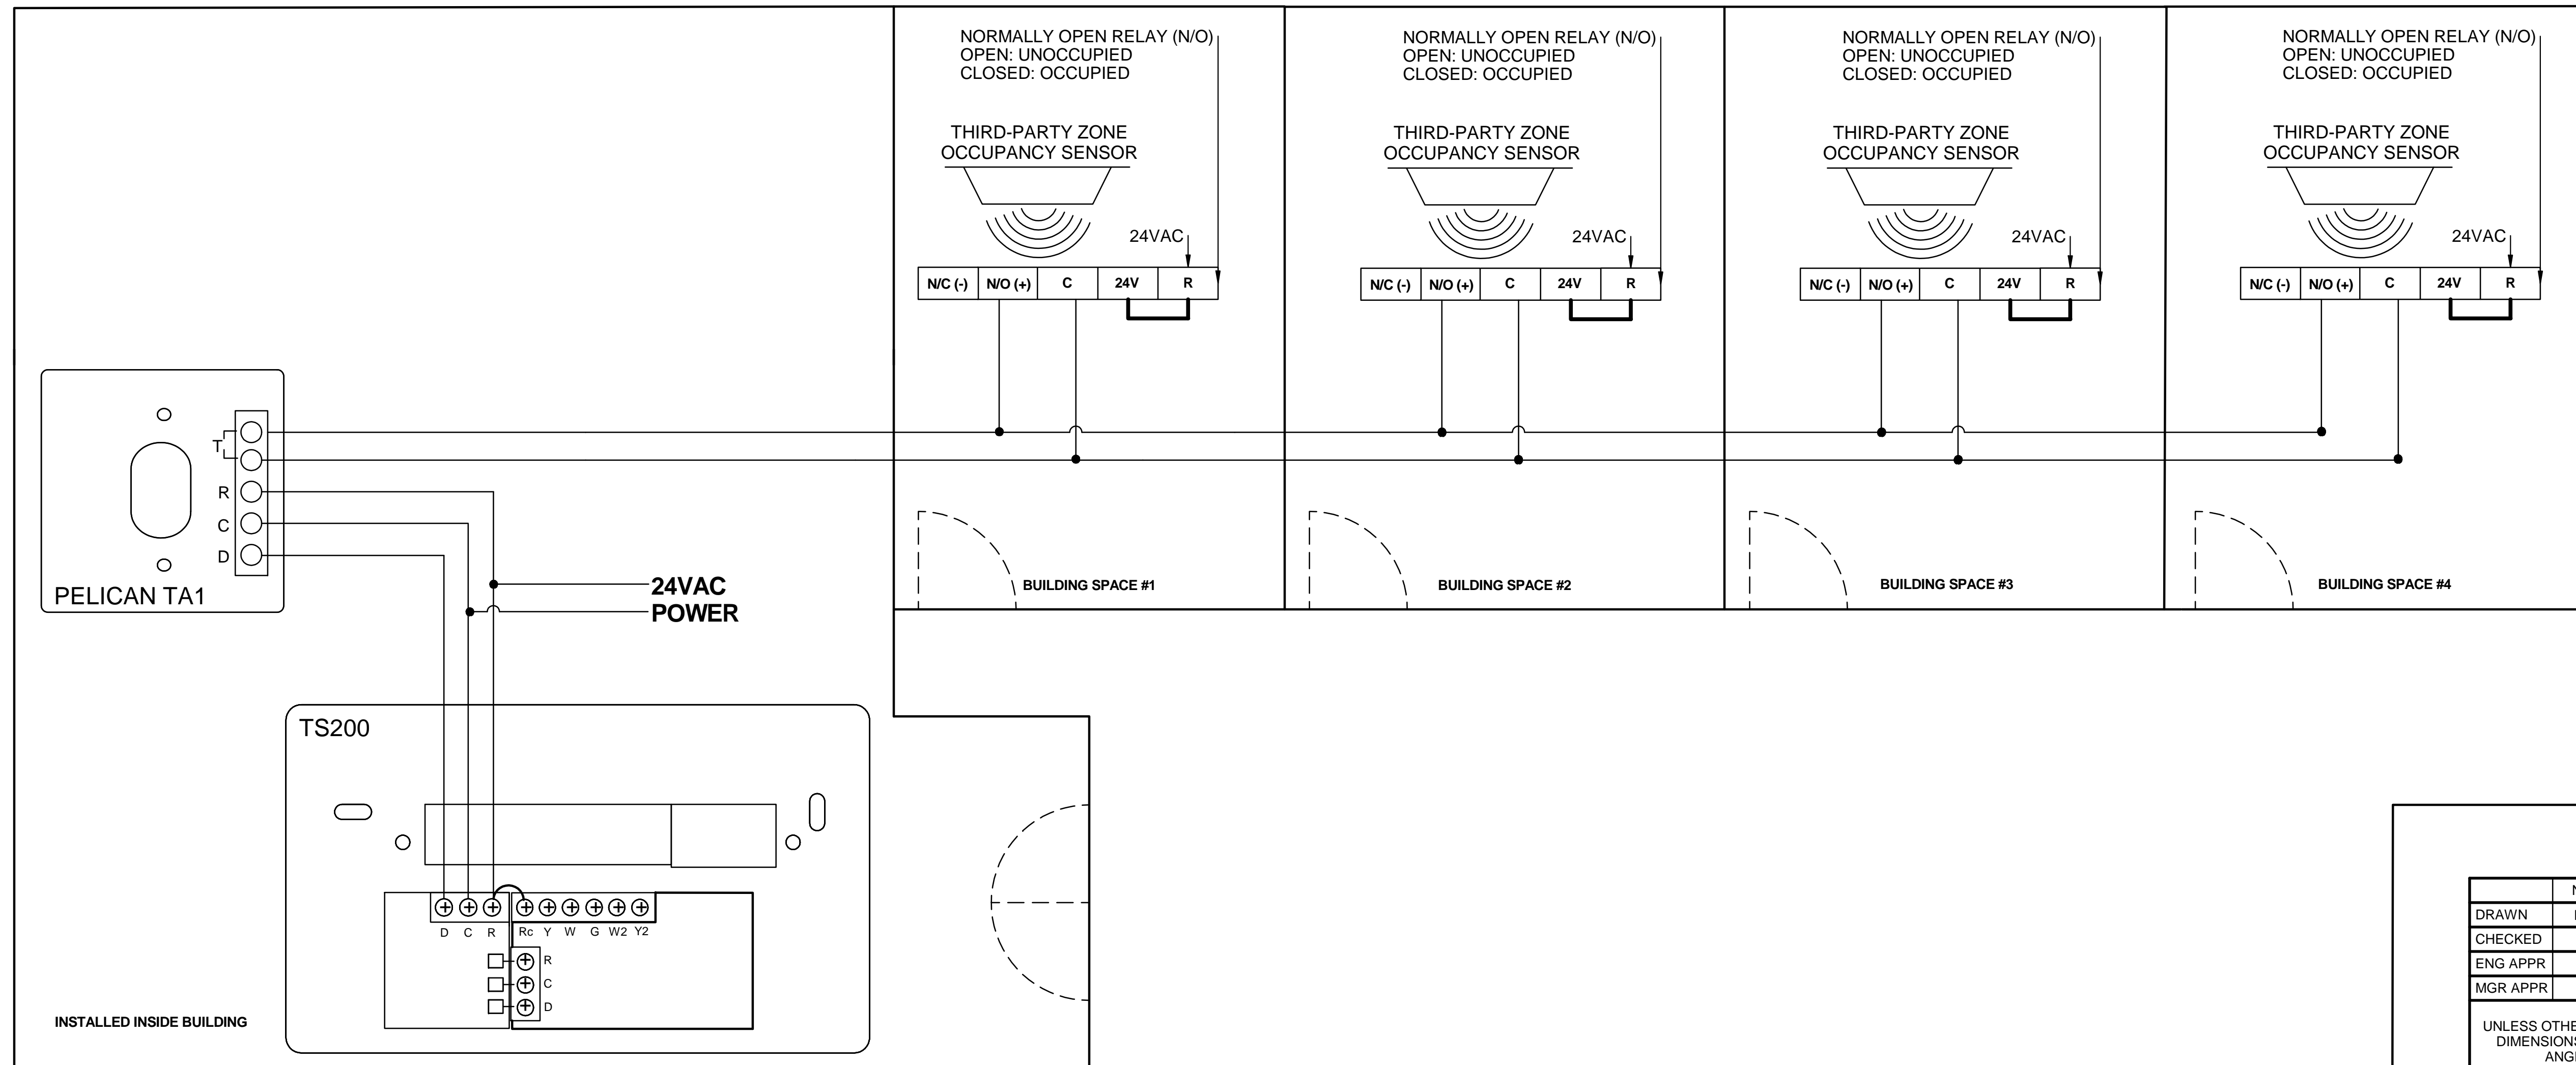

NOTES:

UP TO 500 FT. MAXIMUM DISTANCE BETWEEN DEVICES.

PELICAN GATEWAY REQUIRED FOR SETUP AND CONFIGURATION.

	NAME	DATE	PELICAN WIRELESS	
DRAWN	PWS	10/23/2019	TITLE	
CHECKED			Wired_Parallel	
ENG APPR			SIZE DWG NO	
MGR APPR			D	PW-190050-1
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES			REV	1
ANGLES ±X.X°			FILE NAME: PW-190050-1 Occupancy-Wired_Wireless.dft	
2 PL ±X.XX 3 PL ±X.XXX			SCALE:	WEIGHT:
			SHEET 1 OF 2	