



**OCCUPANCY SENSORS WIRED TO A PELICAN PRX1 THAT WIRELESSLY COMMUNICATES TO PELICAN THERMOSTAT**

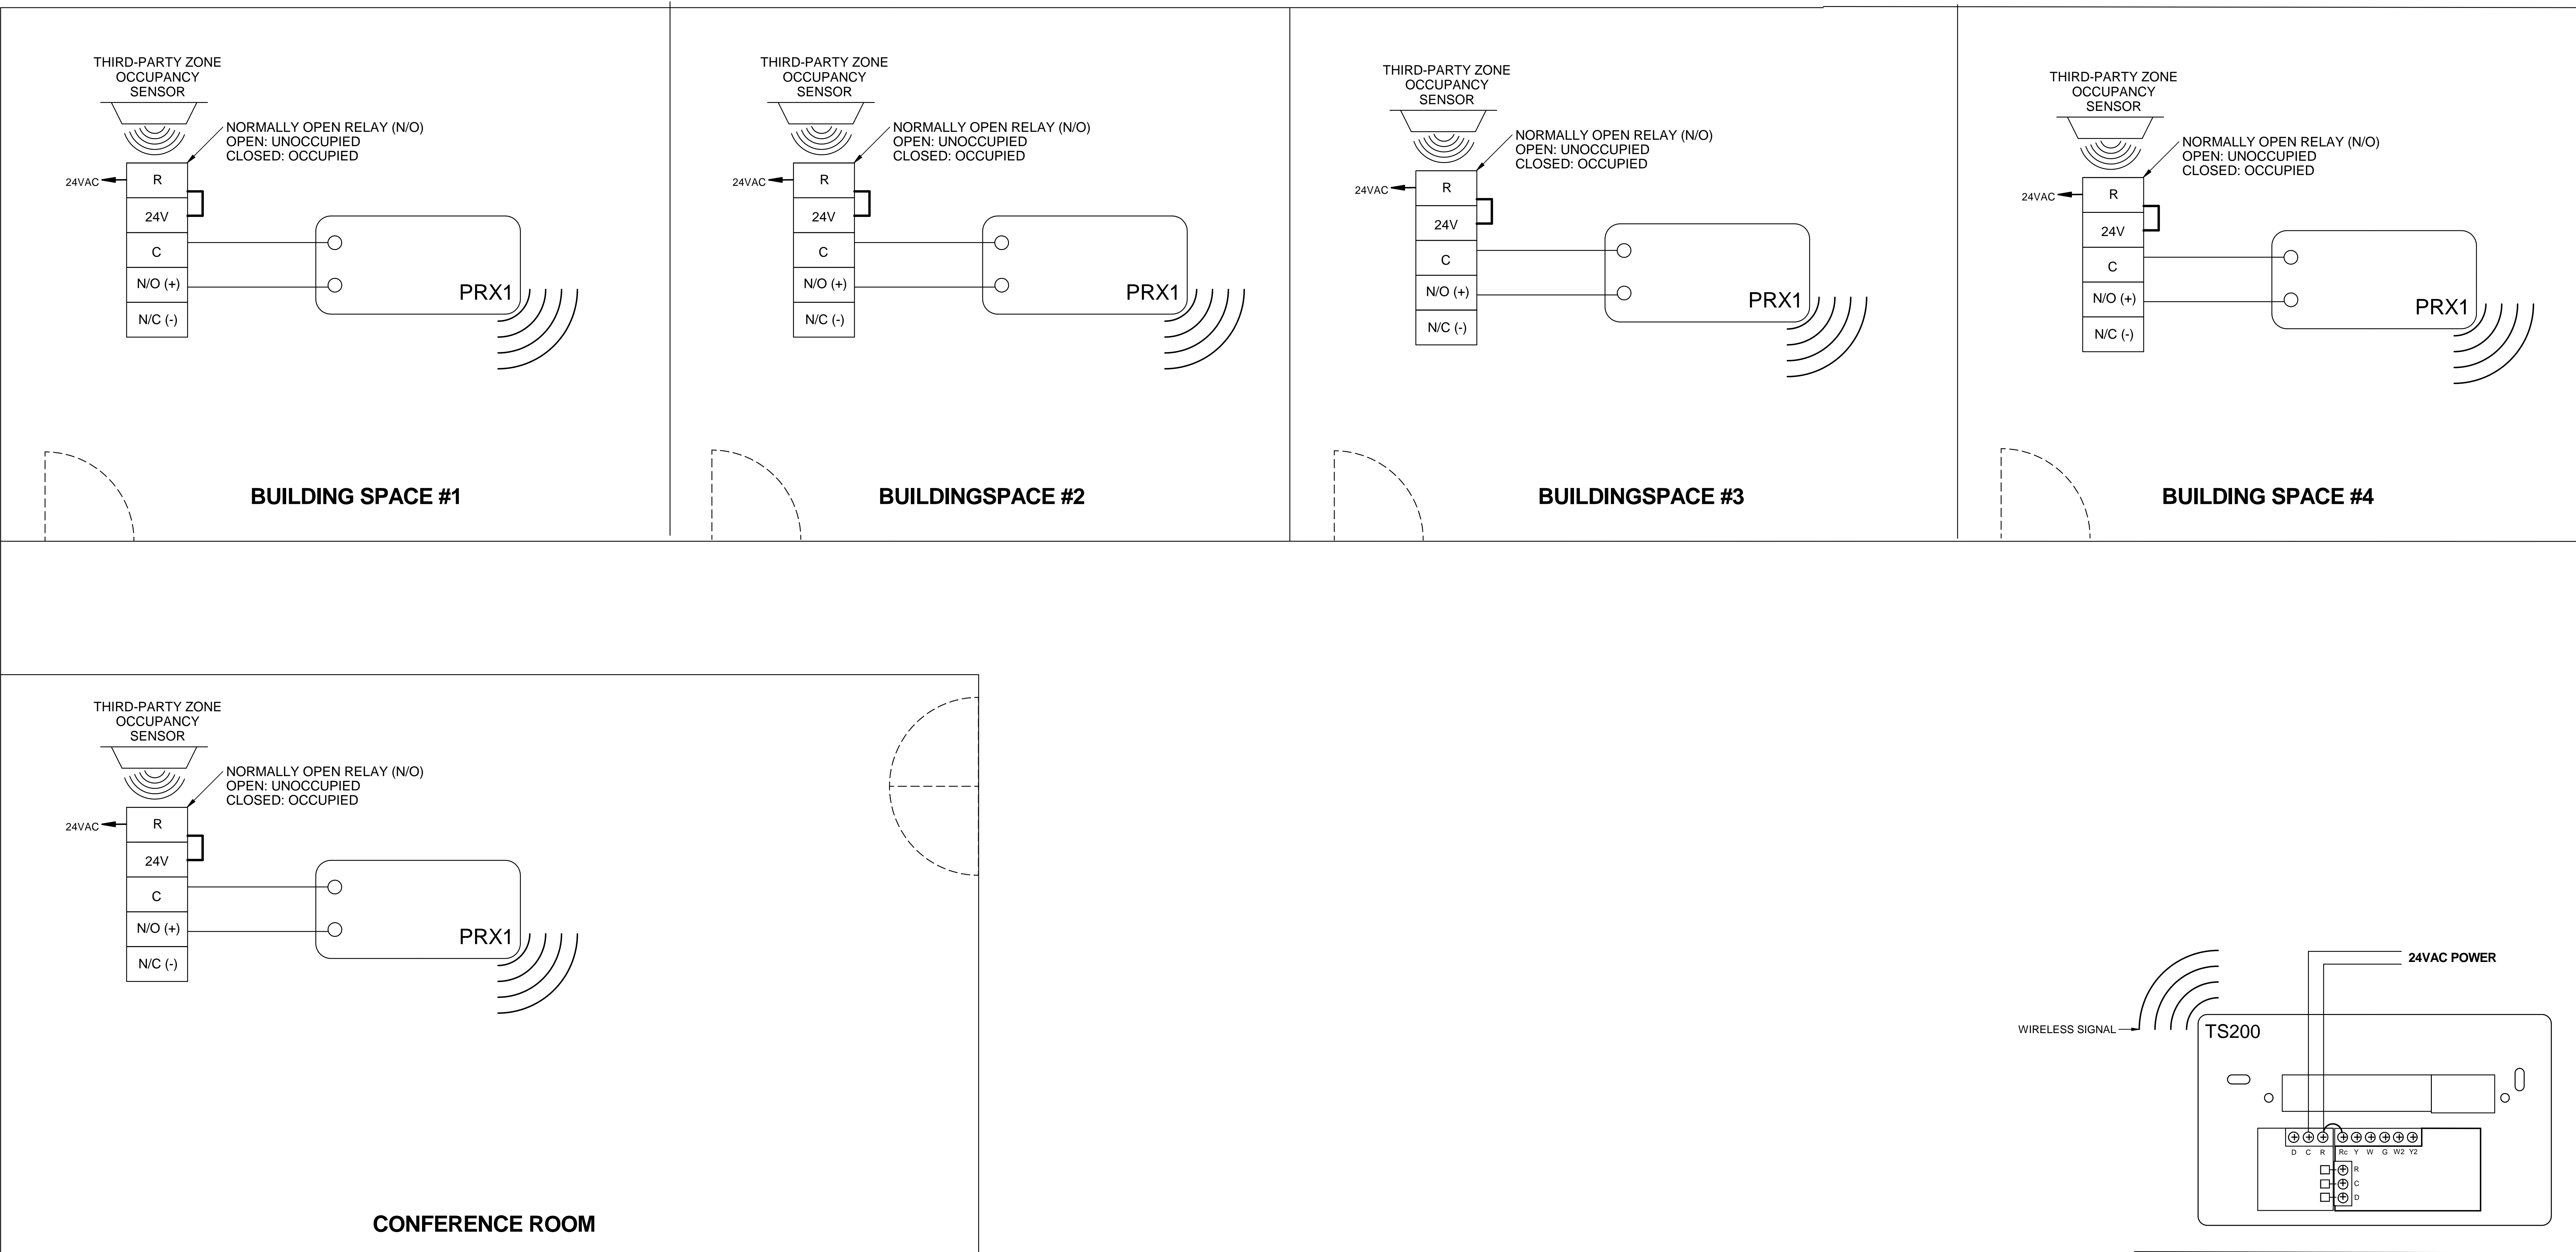

**NOTES:**  
 A SINGLE PELICAN THERMOSTAT CAN CONNECT TO EIGHT (8) PRX1 SENSORS.  
 PELICAN GATEWAY REQUIRED FOR SETUP AND CONFIGURATION.

<b>PROJECT NUMBER:</b> D-20032902	<b>REV. NO.</b> REV01	<b>DRAWING TITLE:</b> Occupancy Sensors Wireless - PRX1	<b>DRAWN BY:</b> PWS	<b>SCALE:</b> NTS	
	<b>PROJECT NAME:</b> Occupancy Sensors		<b>DATE CREATED:</b> 3/31/2020	<b>PAGE 1 OF 1</b>	